



BEFORE YOU BEGIN
Read and follow all safety instructions



WARNING

RISK OF FIRE, EXPLOSION AND ELECTRIC SHOCK

- This product should be installed, inspected, and maintained by a qualified electrician only, in accordance with the NEC (National Electric Code) and all local codes.
- Turn off electrical power before inspection, installation or removal.
- Use only UL (or other NRTL) approved wire for input/output connections.
- Make sure LEDs and drivers are cool to touch when performing maintenance. Make sure the supply voltage is the same as the rated voltage of the luminaire.
- Do not install in a hazardous atmosphere, except where the ambient temperature does not exceed the rated operating temperature of the fixture.
- Keep tightly closed when in operation



Prepare Electrical Wiring



Electrical Requirements

Must check if the local voltage range is correspond with the working voltage of the fixture. Use min. 75°C supply.



Grounding Instructions

The grounding and bonding of the overall system shall be done in accordance with NEC Article 600 and local codes.




Follow all applicable safety procedures and use Personal Protective Equipment such as hardhats, safety glasses, reflective vest, electrical safety gloves, fall protection equipment and safety toe boots during the installation, operation, and maintenance of the luminaire.

PENDANT - STEP ONE INSTALL MOUNTING POINTS

- Non-power feed mounting points may be positioned 1" to 12" or 12" to 18" from the end of the luminaire.
- Recommended that mounting point be positioned within 12 inches of end cap for support

● = Power Feed Knock Out


○ = Non-Power Feed Canopy

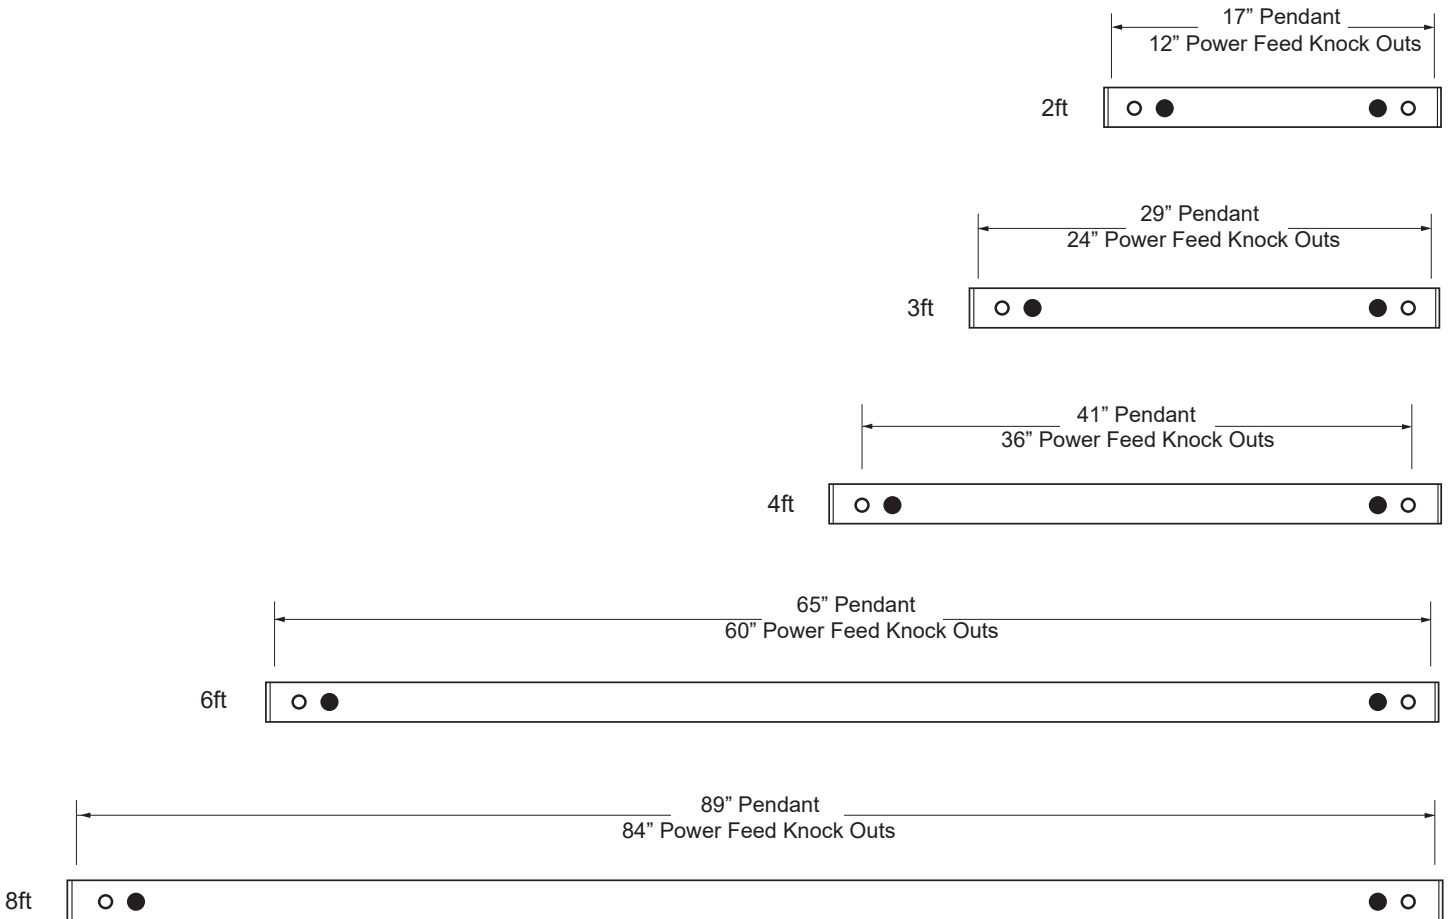

PENDANT - STEP TWO INSTALL POWER FEED MOUNT


- All electrical circuits should be turned off before starting work.
- Please follow local and national electrical codes.

- A - Install junction box (not included) at appropriate location.
- B - Feed power wires into junction box and ground appropriately.
- C - Install Bracket Bar to junction box using ground screws.
- D - Install Threaded Stud into Bracket Bar.
- E - Feed Aircraft Cable and through Terminals and Threaded Stud.
- F - Thread Canopy on to aircraft cable.

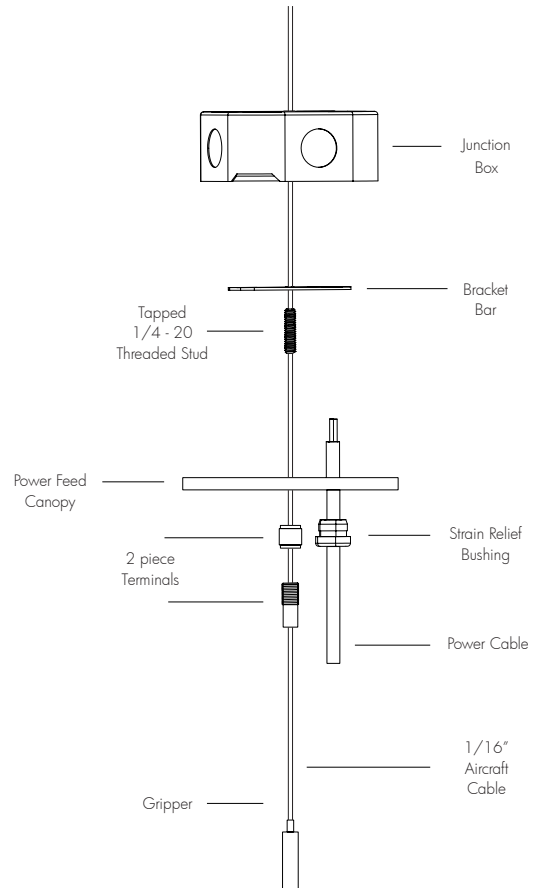

PENDANT - STEP THREE INSTALL NON-POWER FEED MOUNT

- A - Install threaded stud (not included) into ceiling.
- B - Install non-power feed canopy onto threaded stud.
- C - Install aircraft cable and terminal to hold canopy in place.

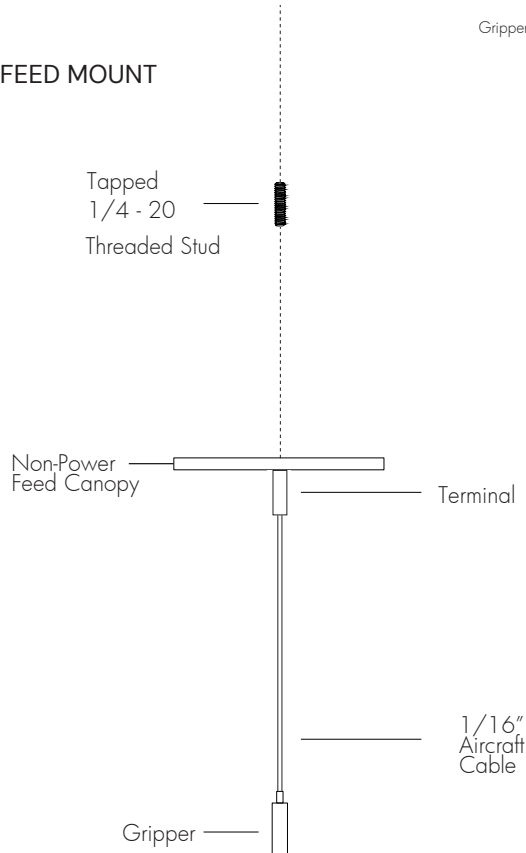

PENDANT – STEP FOUR HANG LUMINAIRE

A - Lift luminaire into place, and insert aircraft cables into cable grippers

B - Adjust height of luminaire and level. Luminaire can be raised by pulling cable through the gripper and can be lowered by depressing the top cylinder on the gripper which pulls the luminaire down.

C - Make sure all parts are tightened and insert strain relief into canopy, pulling cable through the gripper and can be lowered by depressing the top cylinder on the gripper which pulls the luminaire down.

