


### PENDANT - STEP ONE INSTALL MOUNTING POINTS

- Non-power feed mounting points may be positioned 1" to 12" or 12" to 18" from the end of the luminaire.
- Recommended that mounting point be positioned within 12 inches of end cap for support

● = Power Feed Knock Out


○ = Non-Power Feed Canopy

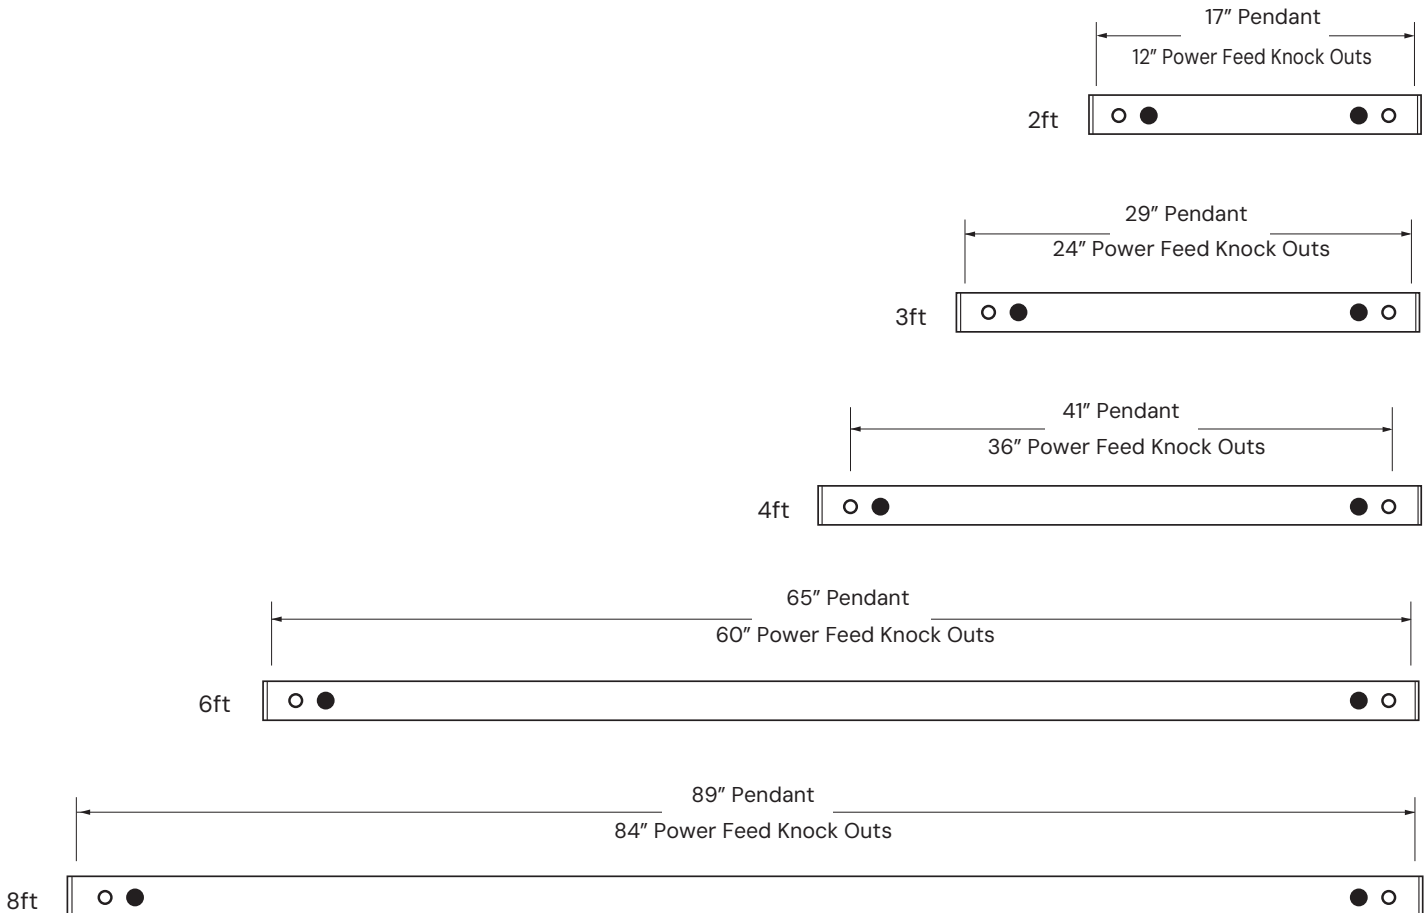

- All electrical circuits should be turned off before starting work.
- Please follow local and national electrical codes.


### PENDANT – STEP TWO INSTALL POWER FEED MOUNT

- A** – Install junction box (not included) at appropriate location.
- B** – Feed power wires into junction box and ground appropriately.
- C** – Install Bracket Bar to junction box using ground screws.
- D** – Install Threaded Stud into Bracket Bar.
- E** – Feed Aircraft Cable and through Terminals and Threaded Stud.
- F** – Thread Canopy on to aircraft cable.

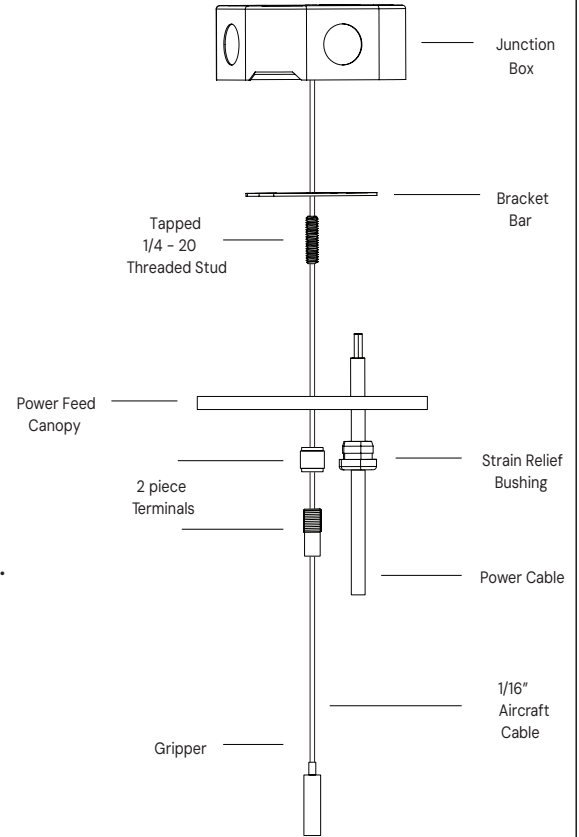

### PENDANT – STEP THREE INSTALL NON-POWER FEED MOUNT

- A** – Install threaded stud (not included) into ceiling.
- B** – Install non-power feed canopy onto threaded stud.
- C** – Install aircraft cable and terminal to hold canopy in place.

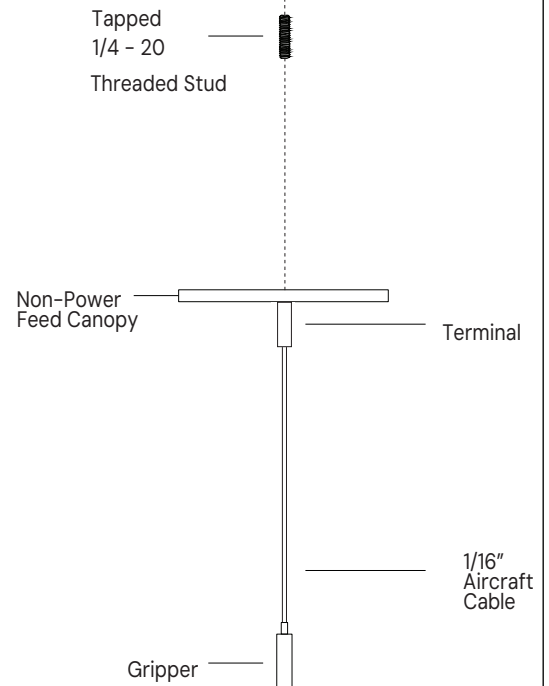

### PENDANT - STEP FOUR

### HANG LUMINAIRE

- A** - Lift luminaire into place, and insert aircraft cables into cable grippers
- B** - Adjust height of luminaire and level. Luminaire can be raised by pulling cable through the gripper and can be lowered by depressing the top cylinder on the gripper which pulls the luminaire down.
- C** - Make sure all parts are tightened and insert strain relief into canopy, pulling cable through the gripper and can be lowered by depressing the top cylinder on the gripper which pulls the luminaire down.

